


CONCRETE

nailable

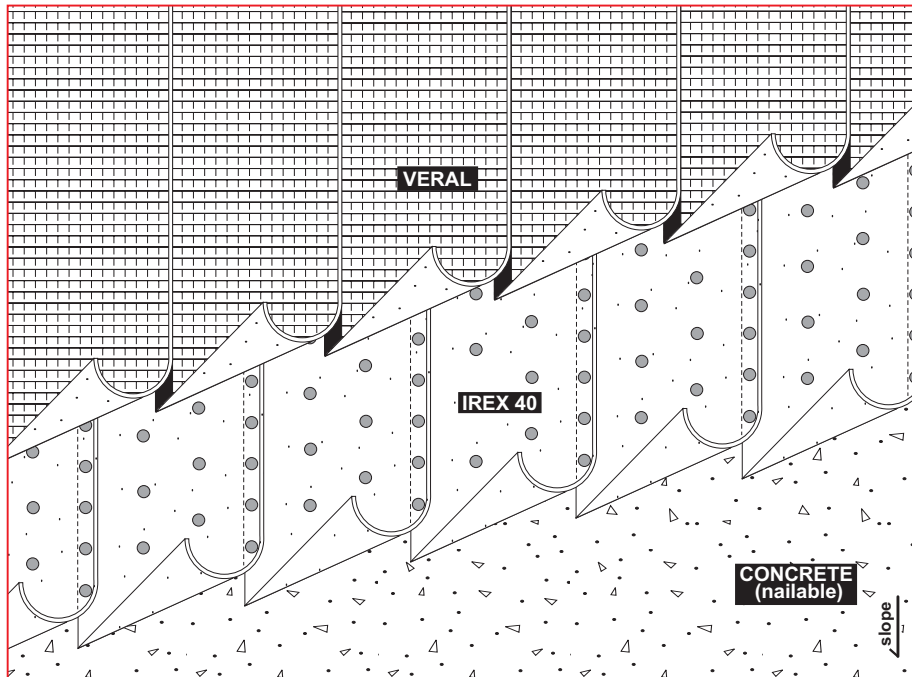

SLOPE 2½" per foot min*

MATERIALS per 100 sq ft

IREX 40	85 lb
VERAL ALUMINUM	96 lb
or	
VERAL STAINLESS	94 lb

* Contact Siplast for lower slope requirements.

n.t.s.

SPECIFICATION 4040 CBT

Requirements and recommendations detailed in the Siplast catalog and Siplast long form specifications shall apply in addition to the following recommendations and specifications.

APPLICATION

1. Lay one ply of Irex 40 dry over the entire area to be roofed. Lap each sheet 3 inches over the underlying sheet and lap ends 6 inches. Using approved fasteners, nail each sheet every 9 inches through the laps and stagger nail the remainder of the sheet in two rows on nominal 12 inch centers with fasteners in each row on 12 inch centers. *The fastening pattern shown in this specification is based on Siplast standard nailing requirements. Contact Siplast for recommended fastening patterns to meet specific testing or code approvals.*
2. Fully torch one ply of Veral Aluminum or Veral Stainless Steel to the Irex 40 surface, lapping sides and ends a minimum of 3 inches. Offset end laps a minimum of 3 feet. Stagger laps between the base sheet and finish ply.

Notes: Slopes over 3½" per foot require backnailing of the Veral plies.
Prime foil surfaces to be lapped by adjoining sheets.
Venting provisions must be incorporated into lightweight insulating concrete designs.

Caution: Siplast recommends that all practices pertaining to NRCA CERTA guidelines be followed when torching methods are employed. This includes performing a fire watch following any torch applications. Always have approved fire-extinguishing equipment nearby.

Ref #: 1440CBT-V
Rev: 10.29.08



1000 East Rochelle Boulevard Irving, Texas 75062 (800) 922-8800 FAX (469) 995-2206



An Icopal Group Company