


CONCRETE

non-nailable

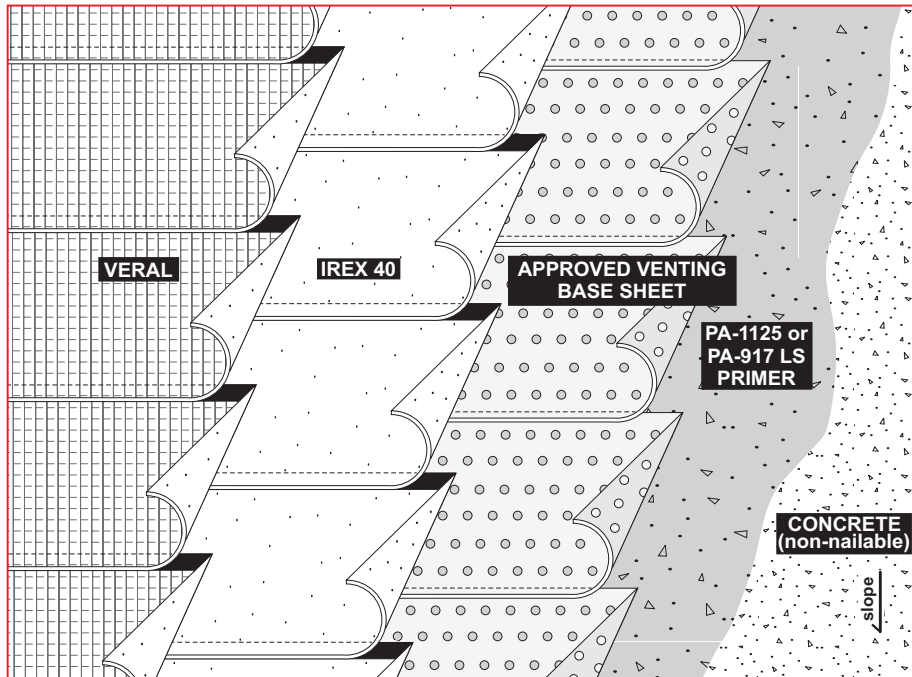

SLOPE	1/2" per foot min*
MATERIALS	per 100 sq ft
PA-1125 or PA-917 LS PRIMER	1 gal
VENTING BASE SHEET	
IREX 40	85 lb
VERAL ALUMINUM	96 lb
or	
VERAL STAINLESS	94 lb

* Contact Siplast for lower slope requirements.

n.t.s.

SPECIFICATION 4040 CPT

Requirements and recommendations detailed in the Siplast catalog and Siplast long form specifications shall apply in addition to the following recommendations and specifications.

APPLICATION

1. Prime the entire deck using PA-1125 or PS-917 LS Primer and allow to dry thoroughly. Lay one ply of an approved venting base sheet dry, with side and end laps a maximum of 1 inch.
2. Beginning at the low point of the roof, fully torch one ply of Irex 40 to the venting base sheet surface, lapping sides and ends a minimum of 3 inches. Offset end laps a minimum of 3 feet.
3. Beginning again at the low point of the roof, fully torch one ply of Veral Aluminum or Veral Stainless to the Irex 40 surface, lapping sides and ends a minimum of 3 inches. Offset end laps a minimum of 3 feet. Stagger laps between plies.

Slopes over 2 1/2" per foot: Run plies parallel to the slope of the roof. Both the Irex and Veral must be backnailed on slopes in excess of 3 1/2" per foot.

NOTE: Prime foil surfaces to be lapped by adjoining sheets.

Caution: Siplast recommends that all practices pertaining to NRCA CERTA guidelines be followed when torching methods are employed. This includes performing a fire watch following any torch applications. Always have approved fire-extinguishing equipment nearby.

Ref #: 1440CPT
Rev: 10.29.08



1000 East Rochelle Boulevard Irving, Texas 75062 (800) 922-8800 FAX (469) 995-2206



An Icopal Group Company